

Multi- Aperture cores (2843010402)

Part Number: 2843010402

43 MULTI- APERTURE CORE

Explanation of Part Numbers:

- Digits 1 & 2 = Product Class
- Digits 3 & 4 = Material Grade
- Last digit 2 = Burnished

Multi- aperture cores are used in suppression applications and in balun (balance- unbalance) and other broadband transformers. They are also employed in airbag designs to prevent accidental activation.

All multi- aperture cores are supplied burnished.

Our “Multi- Aperture Core Kit” (part number 0199000036) is available for prototype evaluation.

For any multi- aperture requirement not listed here, feel free to contact our customer service group for availability and pricing.

[Catalog Drawing](#)
[3D Model](#)

Weight: 7.5 (g)

Dim	mm	mm tol	nominal inch	inch misc.
A	19.45	±0.40	0.766	—
B	12.7	±0.50	0.5	—
C	9.5	±0.25	0.374	—
E	9.9	±0.25	0.39	—
H	4.75	±0.20	0.187	—

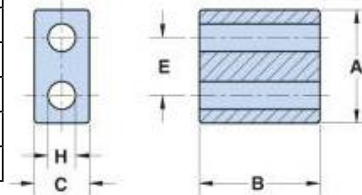


Figure 3

Chart Legend

+ Test frequency


Typical Impedance (Ω)	
25 MHz	142
100 MHz ⁺	202

Multi- aperture cores in 73 and 43 materials are controlled for impedance only. The 61 NiZn material is controlled for both impedance and A_L value. The high frequency 67 material is controlled for A_L value. Minimum impedance values are specified for the + marked frequencies. The minimum impedance is listed on our catalog drawing.

[Catalog Drawing](#)

Multi- aperture cores in 73 and 43 material are measured for impedance on the E4990A Impedance Analyzer. The 61 and 67 multi- aperture cores are tested on the E4991A / HP4291B Impedance Analyzer. All impedance measurements are performed with a single turn to both holes, using the shortest practical wire length.

The 61 and 67 material multi- hole beads are tested for A_L value. The test frequency is 10 kHz at < 10 gauss. The test winding is five turns wound through both holes.

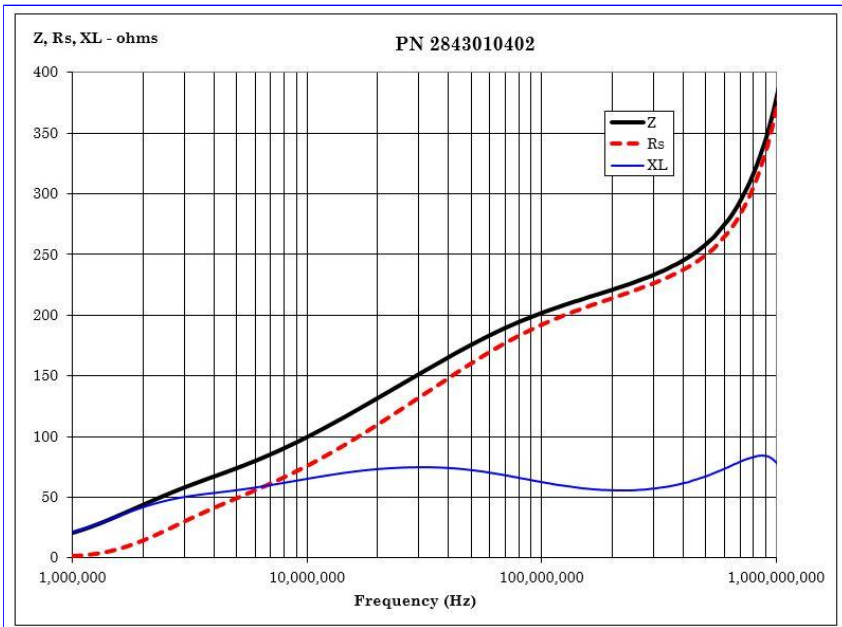

[CSV Download](#)

Fair- Rite Products Corp. • One Commercial Row, Wallkill, New York 12589-0288
888-324-7748 • 845-895-2055 • Fax: 845-895-2629 • [\[email protected\]](#) • www.fair-rite.com